

Submittal


Split System Air Conditioner

A4AC3018A1000B



Note: "Graphics in this document are for representation only. Actual model may differ in appearance."

Outline Drawing

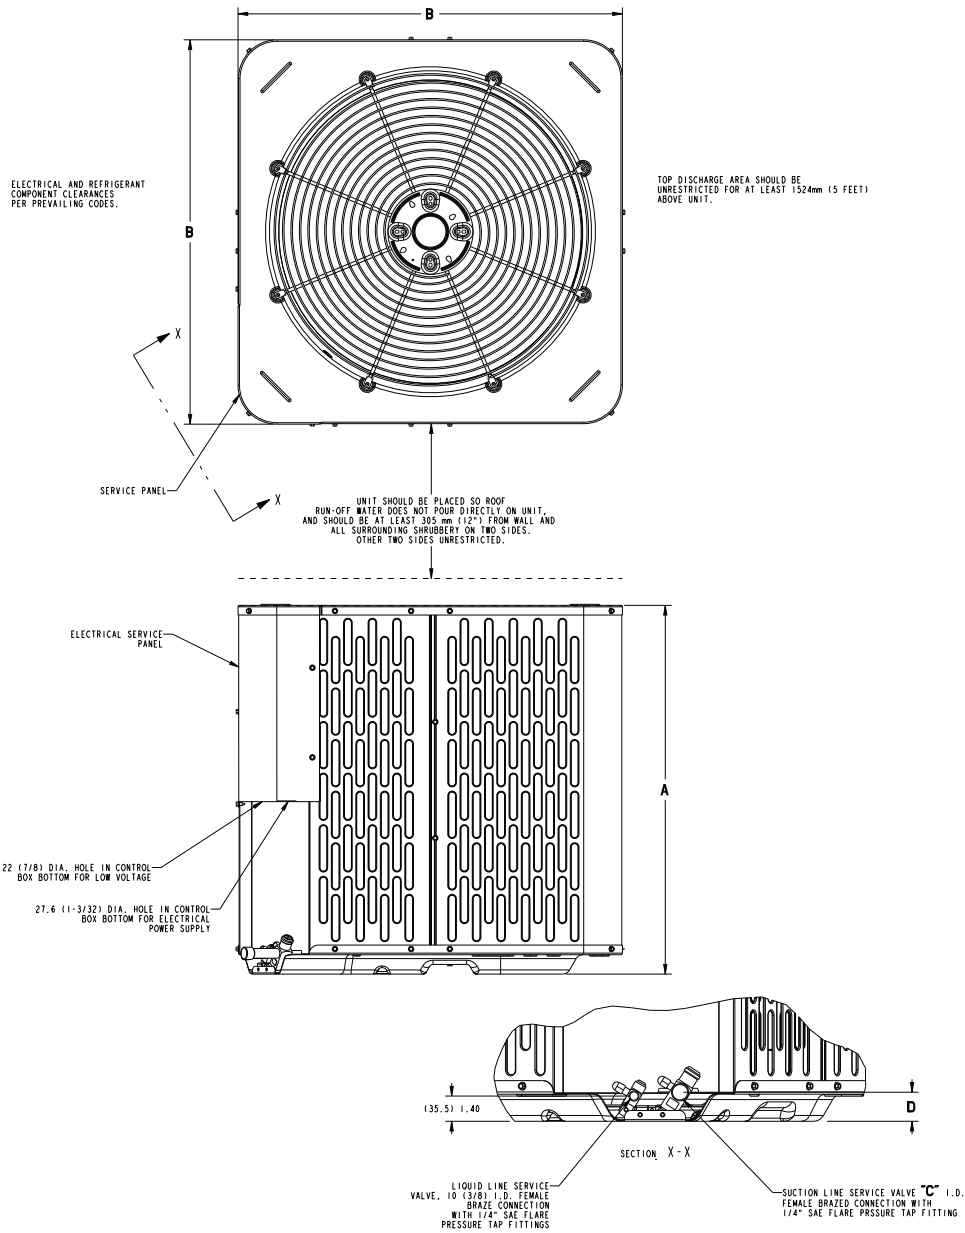

| Model | Base | A | B | C | D |
|-----------|------|--------------|--------------|----------|------------|
| A4AC3018A | 1A.2 | 727 (28-5/8) | 600 (23-5/8) | 19 (3/4) | 41 (1-5/8) |

| SOUND POWER LEVEL | | | | | | | | | |
|-------------------|--------------------------------------|------------------------------|--------|--------|--------|---------|---------|---------|---------|
| Model | A-Weighted Sound Power Level [dB(A)] | Full Octave Sound Power [dB] | | | | | | | |
| | | 63 Hz | 125 Hz | 250 Hz | 500 Hz | 1000 Hz | 2000 Hz | 4000 Hz | 8000 Hz |
| A4AC3018A | 74 | 73.7 | 71.4 | 65.4 | 68 | 67.3 | 62.9 | 56 | 50.3 |

Note: Rated in accordance with AHRI Standard 270-2008

Product Specifications

| | |
|--|--------------------|
| OUTDOOR UNIT ^(a) ^(b) | A4AC3018A1000B |
| POWER CONNS. — V/PH/HZ ^(c) | 208/230/1/60 |
| MIN. CIR. AMPACITY | 12 |
| MAX. OVERCURRENT PROTECTION | 20 |
| COMPRESSOR | SCROLL |
| NO. USED — NO. STAGES | 1 — 1 |
| VOLTS/PH/HZ | 208/230/1/60 |
| R.L. AMPS ^(d) — L.R. AMPS | 9.0 — 48 |
| FACTORY INSTALLED | YES/NO |
| START COMPONENTS ^(e) | NO |
| INSULATION/SOUND BLANKET | NO |
| COMPRESSOR HEAT | NO |
| OUTDOOR FAN | PROPELLER |
| DIA. (IN.) — NO. USED | 18.06 |
| TYPE DRIVE — NO. SPEEDS | DIRECT — 1 |
| CFM @ 0.0 IN. W.G. ^(f) | 1780 |
| NO. MOTORS — HP | 1 — 1/12 |
| MOTOR SPEED R.P.M. | 810 |
| VOLTS/PH/HZ | 208/230/1/60 |
| F.L. AMPS | 0.85 |
| OUTDOOR COIL — TYPE | ALL ALUMINUM |
| ROWS — F.P.I. | 1 — 24 |
| FACE AREA (SQ. FT.) | 12.41 |
| TUBE SIZE (IN.) | 3/8 |
| REFRIGERANT | |
| LBS. — R-410A (O.D. UNIT) ^(g) | 4 LBS., 2 OZ |
| FACTORY SUPPLIED | YES |
| LINE SIZE — IN. O.D. GAS ^(h) ⁽ⁱ⁾ | 3/4 |
| LINE SIZE — IN. O.D. LIQ. | 3/8 |
| CHARGING SPECIFICATIONS | |
| SUBCOOLING | 10°F |
| DIMENSIONS | H X W X D |
| CRATED (IN.) | 31.7 x 24.9 x 24.9 |
| WEIGHT | |
| SHIPPING (LBS.) | 152 |
| NET (LBS.) | 130 |

- (a) Certified in accordance with the Air-Source Unitary Air-conditioner Equipment certification program, which is based on AHRI standard 210/240.
- (b) Rated in accordance with AHRI standard 270.
- (c) Calculated in accordance with Natl. Elec. Codes. Use only HACR circuit breakers or fuses.
- (d) This value shown for compressor RLA on the unit nameplate and on this specification sheet is used to compute minimum branch circuit ampacity and max. fuse size. The value shown is the branch circuit selection current.
- (e) No means no start components. Yes means quick start kit components. Optional authorized kits include KIT07689 for RunTru or BAYKSKT267.
- (f) Standard Air — Dry Coil — Outdoor
- (g) This value approximate. For more precise value see unit nameplate.
- (h) Reference the outdoor unit ship-with literature for refrigerant piping length and lift guidelines. Reference the refrigerant piping software pub # 32-3312-xx or refrigerant piping application guide SS-APG006-xx for long line sets or specialty applications (xx denotes latest revision).
- (i) The outdoor condensing units are factory charged with the system charge required for the outdoor condensing unit, ten (10) feet of tested connecting line, and the smallest rated indoor evaporative coil match. Always verify proper system charge via subcooling (TXV/EEV) or superheat (fixed orifice) per the unit nameplate.

Mechanical Specification Options

General

The outdoor condensing units are factory charged with the system charge required for the outdoor condensing unit, ten (10) feet of tested connecting line, and the smallest rated indoor evaporative coil match. This unit is designed to operate at outdoor ambient temperatures as high as 115°F. Cooling capacities are matched with a wide selection of air handlers and furnace coils that are AHRI certified. The unit is certified to UL 1995. Exterior is designed for outdoor application.

Casing

Unit casing is constructed of heavy gauge, galvanized steel and painted with a weather-resistant powder paint finish. The corner panels are prepainted. All panels are subjected to our 1,000 hour salt spray test .

Refrigerant Controls

Refrigeration system controls include condenser fan, compressor contactor and low and high pressure switches.

Compressor

The compressor features internal over temperature and pressure protection. Other features include: Centrifugal oil pump and low vibration and noise.

Condenser Coil

The outdoor coil provides low airflow resistance and efficient heat transfer. The coil is protected on all four sides by louvered panels.

Low Ambient Cooling

As manufactured, this system has a cooling capacity to 55°F. The addition of an evaporator defrost control permits operation to 40°F. The addition of an evaporator defrost control with TXV permits low ambient cooling to 30°F.

The addition of the BAYLOAM108 low ambient kit permits ambient cooling to 20°F.

Thermostats—Cooling only and heat/cooling (manual and automatic change over). Sub-base to match thermostat and locking thermostat cover.

About Trane and American Standard Heating and Air Conditioning

Trane and American Standard create comfortable, energy efficient indoor environments for residential applications. For more information, please visit www.trane.com or www.americanstandardair.com.



The AHRI Certified mark indicates company participation in the AHRI Certification program. For verification of individual certified products, go to ahridirectory.org.

The manufacturer has a policy of continuous data improvement and it reserves the right to change design and specifications without notice. We are committed to using environmentally conscious print practices.